TECHNICAL DATA SERIES

SDI 108-23

Recommended Selection and Usage Guide for Standard Steel Doors



Recommended Selection and Usage Guide for Standard Steel Doors

Purpose

To establish guide criteria for the selection and usage of 1-3/4" and 1-3/8" standard steel doors.

Selection

Standard steel doors are classified in four levels: Level 1 - 1- $^{3}4$ " and 1- $^{3}8$ " standard duty, Level 2 - 1- $^{3}4$ " heavy duty, Level 3 - 1- $^{3}4$ " extra heavy duty and Level 4 - 1- $^{3}4$ " maximum duty.

Each of the four levels noted above offer a range of door construction models and designs to meet architectural requirements for preference and appearance. The standard steel door construction models are full flush, seamless, and stile and rail.

Recommended minimum gauge requirements for the various levels and models of standard steel doors are indicated in table 1.

Usage

Selection of standard steel doors for general usage is made by analyzing criteria such as frequency of use, including subjection to and degree of possible abuse. Other criteria to be considered for door selection are: conformance to local building codes and fire code

Duty

regulations; sound attenuation and/or insulation requirements; and architectural design and appearance.

Table 2 is a reference aid matching standard duty, heavy duty, extra heavy duty and maximum duty doors with general usage requirements within the classification of buildings. Where optional door levels and models are indicated, further analysis on an individual job basis is recommended.

When unusual or special door usage conditions are encountered, contact a representative member of the Steel Door Institute for consultation and guidance.

Notes

Tolerances – All values which do not carry specific tolerances or are not marked maximum or minimum shall have the following tolerances: Linear dimensions shall be \pm 1/16 in. (1.6 mm). Weight or force shall be \pm 2%. Angles shall be \pm 2 degrees. Where only minus tolerances are given, the dimensions are permitted to be exceeded at the option of the manufacturers.

Gauge vs. Thickness – While the term *gauge* is no longer common for defining material thickness it is still used to specify doors and frames for ordering purposes. The term *thickness* is used when defining the actual dimension of an item, and the term *gauge* is used in the context of specifying a particular door or frame.

Seamless

Level		Model	Ful	Construction		
		Model	MSG No. IP in		SI mm	Construction
	Standard Duty	1	20	0.000	0.8	Full Flush
I		2		0.032		Seamless
2	Heavy Duty	1	18	0.042	1	Full Flush
		2				Seamless
3	Extra Heavy Duty	1	16	0.053	1.3	Full Flush
		2				Seamless
		3				*Stile & Rail
4	Maximum	1	4.4	0.067	4.0	Full Flush
4			0.067	16		

Table 1 - Standard steel door levels and models

2

For complete standard steel door construction specifications and available sizes, refer to ANSI/SDI A250.8-2017, Specifications for Standard Steel Doors and Frames (SDI-100) and ANSI/SDI A250.4-2022 Test Procedure and Acceptance Criteria for Physical Endurance for Steel Doors, Frames and Frame Anchors.


^{*}Stiles and rails are 16 gauge; flush panels, when specified, are 18 gauge.

Table 2 – Suggested door levels and applications

	Standard Steel Door Levels				Door Design Nomenclature					
Building Types	Level 1 Standard Duty	Level 2 Heavy Duty	Level 3 Extra Heavy Duty	Level 4 Maxi- mum Duty						
	1-98	1-¾" only	1-¾" only	1-¾" only	F	G	V	FG	N	L
Apartment			-							
Main Entrance		•	•		•	•				
Unit Entrance	•	•	•		•					
Bedroom	•				•					
Restroom	•				•					•
Closet	•				•					•
Stairwell		•	•				•		•	
Mechanical		•	•		•					•
Dormitory										
Main Entrance		•	•	•		•		•	•	
Unit Entrance	•	•			•					
Bedroom	•	•			•					
Restroom	•	•			•					•
Closet	•	•			•					•
Stairwell		•	•				•		•	
Hotel – Motel								I	1	
Unit Entrance Restroom	•	•			•					
Closet	•				•					
Stairwell	•	_	_		•		_			•
Storage & Utility		•	•		•		•		•	
Medical		•			•					
Main Entrance	Ĭ		•	Ĭ		•				
Patient Room		•	•		•	•		•	1	
Stairwell		•	•		_		•		•	
Operating & Exam.		•	•		•		•		•	
Restroom		•	•		•					
Closet	•	•			•					•
Recreation		•			•		•			
Kitchen	1	•	•				•			
Mechanical/Storage/		•	•		•					
Utility										
Industrial										
Entrance & Exit			•	•		•		•	•	
Office	•	•			•	•				
Production			•			•			•	•
Restroom		•	•		•					•
Tooling/Maintenance			•	•	•					
Shipping/Receiving			•	•		•				
Monorail			•	•	•					
Office					I			1	1	1
Entrance			•			•		•	•	
Individual Office	•				•	•				
Closet	•				•					•
Restroom		•	•		•					
Stairwell Equipment		•	•		•		•		•	
Boiler		•	•		•					
School										
Entrance & Exit										
Classroom		•	•	•		•		•		
Restroom		•	•		•	•				
Gymnasium		•	•	•		•	•			
Cafeteria		•	•	_		•				
Stairwell		•	•			•	•			
Closet		•	•	•	•					•
0.3001		_								

Note: Table 2 is only a guide. Please consult ANSI/SDI A250.8 and applicable building codes for additional requirements. For additional designs refer to SDI-134, Nomenclature for Standard Steel Doors and Steel Frames.

Steel Door Institute Standard Steel Door Design Nomenclature

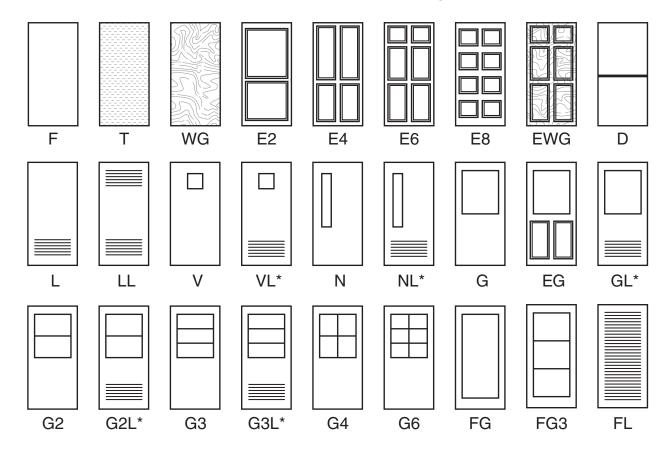

^{*} Note: Design combination is indicated by light followed by louver.

Consult SDI-134 for further information on standard design nomenclature for Standard Steel Doors.

Nomenclature Letter Symbols

F	- Flush	EWG	6 - 6 Panel Embossed and Wood Grain	NL	 Narrow Light and Louvered
Т	Textured	D	Dutch Door	G	- Half Glass (options G2, G3,
WG	Wood Grain	L	Louvered (top or bottom)		G4 and G6)
E2	 2 Panel Embossed 	LL	 Louvered (top and bottom) 	EG	 Embossed and Half Glass
E4	 4 Panel Embossed 	V	Vision Light	GL	 Half Glass and Louvered
E6	 6 Panel Embossed 	VL	 Vision Light and Louvered 	FG	Full Glass (option FG3)
E8	 8 Panel Embossed 	Ν	- Narrow Light	FL	Full Louver

Louvered door designs are further specified as inserted louver (I), pierced (P), or air condition grille (A). When ordering, specify design, louver size and/or free area requirements.

AVAILABLE PUBLICATIONS

Specifications

ANSI/SDI A250.6 Recommended Practice for Hardware Reinforcing on Standard Steel

Doors and Frames

ANSI/SDI A250.8 Specifications for Standard Steel Doors and Frames (SDI-100)

SDI-108 Recommended Selection & Usage Guide for Standard Steel Doors

SDI-118 Basic Fire Door, Fire Door Frame, Transom/Sidelight Frame, and

Window Frame Requirements

SDI-128 Guidelines for Acoustical Performance of Standard Steel Doors and

Frames

SDI-129 Hinge and Strike Spacing

SDI-133 Guideline for Specifying Steel Doors & Frames for Blast Resistance

SDI-136 Guideline for Specifying Windstorm Products

Test Procedures

ANSI/SDI A250.3 Test Procedure & Acceptance Criteria for Factory Applied Finish

Coatings for Steel Doors and Frames

ANSI/SDI A250.4 Test Procedure & Acceptance Criteria for Physical Endurance for

Steel Doors, Frames and Frame Anchors

ANSI/SDI A250.10 Test Procedure & Acceptance Criteria for Prime Painted Steel

Surfaces for Steel Doors and Frames

ANSI/SDI A250.13 Testing and Rating of Severe Windstorm Resistant Components for

Swinging Door Assemblies for Protection of Building Envelopes

(Not applicable for FEMA 320/361 or ICC-500 Shelters)

SDI-113 Standard Practice for Determining the Steady-State Thermal

Transmittance of Steel Door and Frame Assemblies

SDI-131 Accelerated Physical Endurance Test Procedure for Steel Doors

Construction Details

ANSI/SDI A250.11 Recommended Erection Instructions for Steel Frames

SDI-110 Standard Steel Doors & Frames for Modular Masonry Construction

SDI-111 Recommended Details for Standard Steel Doors, Frames,

Accessories and Related Components

SDI-122 Installation Troubleshooting Guide for Standard Steel Doors & Frames

Miscellaneous Documents

SDI-112 Zinc-Coated (Galvanized/Galvannealed) Standard Steel Doors and

Frames

SDI-117 Manufacturing Tolerances for Standard Steel Doors and Frames

SDI-124 Maintenance of Standard Steel Doors & Frames

SDI-127 Industry Alert Series (A-L)
SDI-130 Electronic Hinge Preparations

SDI-134 Glossary of Terms for Hollow Metal Doors and Frames

SDI-135 Guidelines to Measure for Replacement Doors in Existing Frame

Openings



STEEL DOOR INSTITUTE

30200 DETROIT ROAD • CLEVELAND, OHIO 44145 440.899.0010 • www.steeldoor.org

MEMBERS OF THE STEEL DOOR INSTITUTE

CECC

AN ASSA ABLOY DOOR GROUP COMPANY

9159 Telecom Drive Milan, TN 38358-3425 (731) 686-8345 www.cecodoor.com

CURRIES

AN ASSA ABLOY DOOR GROUP COMPANY

1502 12th Street, P.O. Box 1648 Mason City, IA 50402-1648

(641) 423-1334 www.curries.com

DEANSTEEL MANUFACTURING CO.

931 S. Flores Street San Antonio, TX 78204-1406 (210) 226-8271

DE LA FONTAINE INDUSTRIES, INC.

3 Normac Road Woburn, MA 01801 (781) 932-8663 www.delafontaine.com

www.deansteel.com

DCI

7980 Redwood Avenue Fontana, CA 92336-1638 (909) 770-5700 www.dcihollowmetal.com

HOLLOW METAL XPRESS (HMX)

3440 Stanwood Boulevard Huntsville, AL 35811-9021 (256) 851-6670 www.HMXpress.com

MESKER DOOR 3440 Stanwood Boulevard Huntsville. AL 35811-9021

(256) 851-6670 www.meskerdoor.com

MPI

319 North Hills Road Corbin, KY 40701 (606) 523-0173

www.metalproductsinc.com

PIONEER INDUSTRIES, INC.

AN ASSA ABLOY DOOR GROUP COMPANY

111 Kero Road Carlstadt, NJ 07072 (201) 933-1900

www.pioneerindustries.com

PREMIER STEEL DOORS & FRAMES 2840 Sterlington Road

Monroe, LA 71203 (318) 361-0796 www.trustpremier.com

REPUBLIC DOORS & FRAMES

155 Republic Drive McKenzie, TN 38201-0580 (731) 352-3383 www.republicdoor.com

STEELCRAFT 9017 Blue Ash Road Cincinnati, OH 45242 (513) 745-6400 www.steelcraft.com

STILES

AN ASSA ABLOY DOOR GROUP COMPANY

1885 Kinser Road Ceres, CA 95307 (209) 538-3667 www.stilesdoors.com